

Certificate of Analysis

Produced: Mar 18, 2026

Sample: CBD Salve 1000mg (Topical) • Client: CBD Living



Matrix: Topical
 Sample ID: ICC-260316-46-001
 Collected on: Mar 16, 2026
 Received on: Mar 16, 2026
 Batch Size:
 Sample Size:
 Package Size: 60 g

Tests Taken

Potency

Cannabinoid Overview

Δ ⁹ -THC:	0.000 mg/pkg
CBD:	1060 mg/pkg
Total Cannabinoids:	1150 mg/pkg
Sum of Cannabinoids:	1140 mg/pkg

POT-INST-005: POT-INST-005: Potency • Mar 18, 2026 10:13:00 PDT

Analyte	Amt (mg/pkg)	Amt (%)	Amt (mg/g)	LOD/LOQ (mg/g)	Pass/Fail	Analyte	Amt (mg/pkg)	Amt (%)	Amt (mg/g)	LOD/LOQ (mg/g)	Pass/Fail
CBC		ND	ND	0.0272/0.0814	N/A	CBT		ND	ND	0.0118/0.0411	N/A
CBD	1060	1.77	17.7	0.00830/0.0411	N/A	Δ ⁸ -THC		ND	ND	0.00665/0.0411	N/A
CBDA		ND	ND	0.0199/0.0595	N/A	Δ ⁹ -THC		ND	ND	0.0110/0.0411	N/A
CBDV	15.0	0.0250	0.250	0.00658/0.0411	N/A	THCA		ND	ND	0.0151/0.0453	N/A
CBG	67.2	0.112	1.12	0.00937/0.0411	N/A	THCV		ND	ND	0.00508/0.0411	N/A
CBGA		ND	ND	0.0146/0.0439	N/A	Total THC**		ND	ND		
CBL		ND	ND	0.00648/0.0411	N/A	Total CBD**	1060	1.77	17.7		N/A
CBN		ND	ND	0.00937/0.0411	N/A	Total Cannabinoids**	1140	1.91	19.1		N/A

** Total Cannabinoids = Neutral Cannabinoids + (Acidic Cannabinoids * 0.877)

** Total THC = Delta-8-THC + (Delta-8-THCA x 0.877) + Delta-9-THC + (THCA x 0.877)

** Total CBD = CBD + (CBDA x 0.877)

NR= Not Reported, ND= Not Detected, *Reported by Dry Mass*; *analytical instrumentation used Cannabinoids: UHPLC-DAD, Moisture: Mass by Drying, Water Activity: Water Activity Meter, Foreign: Microscope*
 *Density tested at a temperature range between 19-24 °C, *Water Activity tested at a humidity range between 0-90% Relative Humidity. All OA samples are sampled by the client, All California State Compliant samples sampled using SAMPL-SOP-001.



Certificate of Analysis

Produced: Jan 05, 2026

Sample: CBD Salve (Topical) • Client: CBD Living • Batch: Pass



Matrix: Topical
 Sample ID: ICC-251230-37-009
 Collected on: Dec 30, 2025
 Received on: Dec 30, 2025
 Batch Size:
 Sample Size:
 Package Size: 66.02 g

Batch Result: Pass

Metals Pass
 Pesticides Pass

infiniteCAL

HM-INST-003, HM-PREP-001: HM-INST-003, HM-PREP-001: Heavy Metals Testing by ICP-MS • Dec 31, 2025

Analyte	Limit (µg/g)	Amt (µg/g)	LOD/LOQ (µg/g)	Pass/Fail	Analyte	Limit (µg/g)	Amt (µg/g)	LOD/LOQ (µg/g)	Pass/Fail
Arsenic	1.5	0.0105	0.00300/0.00900	Pass	Lead	0.5	ND	0.00100/0.00400	Pass
Cadmium	0.5	ND	0.00100/0.00200	Pass	Mercury	3	ND	0.00500/0.0140	Pass


PEST-GC-INST-003, PEST-GC-PREP-001: PEST-GC-INST-003, PEST-GC-PREP-001: Pesticide Analysis by GC-MS/MS • Jan 05, 2026

Analyte	Limit (µg/g)	Amt (µg/g)	LOD/LOQ (µg/g)	Pass/Fail	Analyte	Limit (µg/g)	Amt (µg/g)	LOD/LOQ (µg/g)	Pass/Fail
Captan	5	ND	0.120/0.358	Pass	Cypermethrin	1	ND	0.0145/0.0435	Pass
Chlordane	Any amt	ND	0.0249/0.0747	Pass	Methyl parathion	Any amt	ND	0.00811/0.0243	Pass
Chlorfenapyr	Any amt	ND	0.0251/0.0753	Pass	Pentachloronitrobenzene	0.2	ND	0.0182/0.0545	Pass
Cyfluthrin	1	ND	0.0186/0.0558	Pass					



PESTMYCO-LC-INST-004, PESTMYCO-LC-PREP-001: PESTMYCO-LC-INST-004, PESTMYCO-LC-PREP-001: Pesticide Analysis by LC-MS/MS • Jan 05, 2026

Analyte	Limit (µg/g)	Amt (µg/g)	LOD/LOQ (µg/g)	Pass/Fail	Analyte	Limit (µg/g)	Amt (µg/g)	LOD/LOQ (µg/g)	Pass/Fail
Abamectin	0.3	ND	0.0500/0.100	Pass	Imazalil	Any amt	ND	0.00937/0.0300	Pass
Acephate	5	ND	0.00629/0.0300	Pass	Imidacloprid	3	ND	0.0231/0.0700	Pass
Acequinocyl	4	ND	0.0280/0.0848	Pass	Kresoxim-methyl	1	ND	0.00982/0.0300	Pass
Acetamiprid	5	ND	0.00718/0.0300	Pass	Malathion	5	ND	0.00673/0.0300	Pass
Aldicarb	Any amt	ND	0.00997/0.0302	Pass	Metalaxyl	15	ND	0.00467/0.0300	Pass
Azoxystrobin	40	ND	0.00400/0.0300	Pass	Methiocarb	Any amt	ND	0.00956/0.0300	Pass
Bifenazate	5	ND	0.00787/0.0300	Pass	Methomyl	0.1	ND	0.0105/0.0318	Pass
Bifenthrin	0.5	ND	0.0162/0.0490	Pass	Mevinphos	Any amt	ND	0.0133/0.0404	Pass
Boscalid	10	ND	0.0106/0.0321	Pass	Myclobutanil	9	ND	0.00963/0.0300	Pass
Carbaryl	0.5	ND	0.00614/0.0300	Pass	Naled	0.5	ND	0.0116/0.0350	Pass
Carbofuran	Any amt	ND	0.00384/0.0300	Pass	Oxamyl	0.2	ND	0.0103/0.0311	Pass
Chlorantraniliprole	40	ND	0.00657/0.0300	Pass	Paclobutrazol	Any amt	ND	0.0111/0.0337	Pass
Chlorpyrifos	Any amt	ND	0.0108/0.0327	Pass	Permethrin	20	ND	0.00396/0.0300	Pass
Clofentezine	0.5	ND	0.00595/0.0300	Pass	Phosmet	0.2	ND	0.00807/0.0300	Pass
Coumaphos	Any amt	ND	0.00712/0.0300	Pass	Piperonylbutoxide	8	ND	0.00869/0.0300	Pass
Daminozide	Any amt	ND	0.0190/0.0576	Pass	Prallethrin	0.4	ND	0.0204/0.0618	Pass
Diazinon	0.2	ND	0.0271/0.0821	Pass	Propiconazole	20	ND	0.0210/0.0637	Pass
Dichlorvos	Any amt	ND	0.0168/0.0508	Pass	Propoxur	Any amt	ND	0.00656/0.0300	Pass
Dimethoate	Any amt	ND	0.00906/0.0300	Pass	Pyrethrins	1	ND	0.00357/0.0300	Pass
Dimethomorph	20	ND	0.0102/0.0308	Pass	Pyridaben	3	ND	0.00834/0.0300	Pass
Ethoprophos	Any amt	ND	0.00586/0.0300	Pass	Spinetoram	3	ND	0.00317/0.0300	Pass
Etofenprox	Any amt	ND	0.00642/0.0300	Pass	Spinosad	3	ND	0.00302/0.0300	Pass
Etoxazole	1.5	ND	0.00498/0.0300	Pass	Spiromesifen	12	ND	0.0103/0.0311	Pass
Fenhexamid	10	ND	0.0147/0.0444	Pass	Spirotetramat	13	ND	0.00992/0.0301	Pass
Fenoxycarb	Any amt	ND	0.0111/0.0335	Pass	Spiroxamine	Any amt	ND	0.00395/0.0300	Pass
Fenpyroximate	2	ND	0.00952/0.0300	Pass	Tebuconazole	2	ND	0.0213/0.0645	Pass
Fipronil	Any amt	ND	0.00568/0.0300	Pass	Thiacloprid	Any amt	ND	0.00348/0.0300	Pass
Fonicamid	2	ND	0.0181/0.0548	Pass	Thiamethoxam	4.5	ND	0.00914/0.0300	Pass
Fludioxonil	30	ND	0.0192/0.0583	Pass	Trifloxystrobin	30	ND	0.00378/0.0300	Pass
Hexythiazox	2	ND	0.0217/0.0657	Pass					

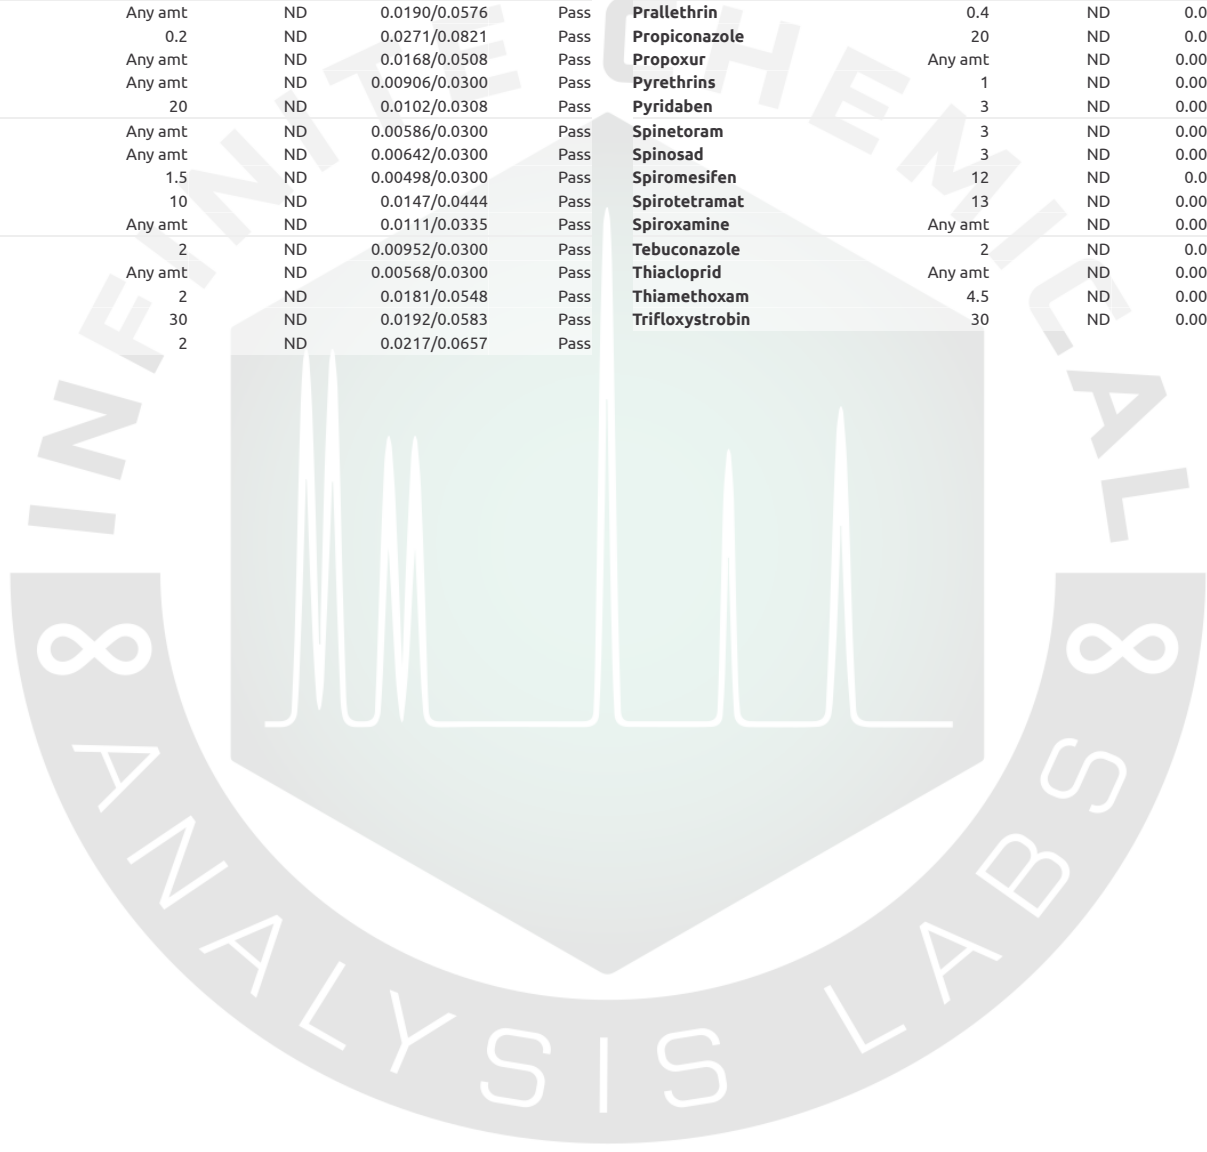

Results Certified By: David Marelius PhD
 Lab Director, Infinite Chemical Analysis Labs, CA
 Jan 05, 2026

DM